

T80 intelligent digital display controller

■ Features

● Can input 22 type signals

RTD: Pt100, Cu50

Thermocouples: S/R/B/K/N/E/J/T with automatic cold junction temperature compensation.

Standard signals: 0-10mA/4-20mA/0-5V/1-5V

Linear non-standard signal: any signals within 0-100mV/0-400Ω, need set the range corresponding to input signal

● SCM intelligence

Can adjust the zero point and magnification manually, and there is no drift in linearity for long-term use

All parameters can be set freely as required

● Alarm control parameters can be set

Can use max four relay outputs

Can set each relay's alarm value and hysteresis

Can set each relay's alarm type (Upper alarm or lower alarm)

● Has various output

Transmission output type: 0-10mA/4-20mA/0-5V/1-5V

Can adjust light beam individually

MODBUS-RTU standard communication protocol.

■ Technical parameter

Measuring range: -1999-9999

Accuracy: ±0.5% of full scale



Supply voltage: AC0220(±10%); DC24V

Operating temperature: 0-50°C

Operating humidity: 85% RH max, non-condensing

Power consumption: ≤5W

■ Panel description (Take 160*80 panel as an example)

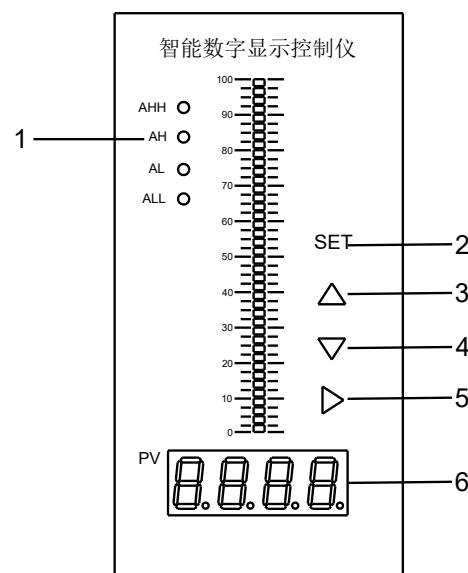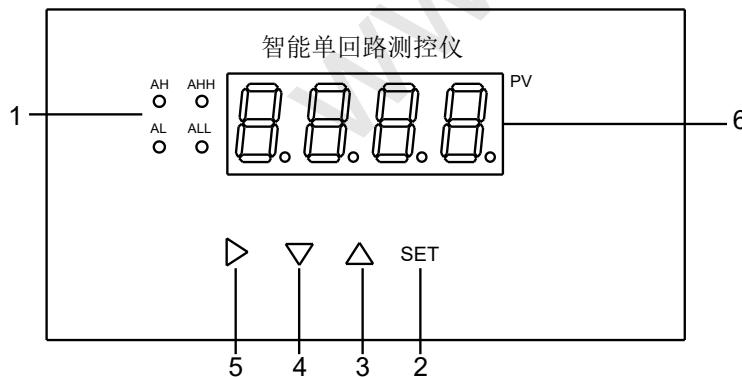

1) Indicator light AH light: The upper limit relay output; AHH light: The upper upper limit relay output

AL light: The lower limit relay output; ALL light: the lower lower limit relay output

2) Function key

3) Add key

4) Minus key

5) Shift key

6) Measurement and function menu display window

■ Model number legend

T	80	- <input type="checkbox"/>	- <input type="checkbox"/>	- <input type="checkbox"/>
Temperature controller	Design code	- Alarms: - 0: No alarm - 3: 2 alarms - 4: 4 alarms	- Communication: - N: None - R: RS485	- Output type: - N: None - C420: 4-20mA - C010: 0-10mA - V15: 1-5V - V05: 0-5V

■ Input type code (corresponding to parameter Sn)

Code	Input type and measured range	Code	Code	Input type and measured range	Code
00	S(0-1600°C)	08	Pt100(-200-850°C)	16	mV no standard signal (0-100mV)
01	R(0-1600°C)	09	Cu50(-50-150°C)	17	Resistance no standard signal (0-400Ω)
02	B(200-1800°C)	10	0-5V(-1999-9999)	18	Frequency no standard signal (0-3000Hz)
03	K(0-1300°C)	11	1-5V(-1999-9999)	19	0-5V²(-1999-9999)
04	N(0-1300°C)	12	0-10V(-1999-9999)	20	1-5V²(-1999-9999)
05	E(0-800°C)	13	0-10mA(-1999-9999)	21	0-10mA²(-1999-9999)
06	J(0-650°C)	14	0-20mA(-1999-9999)	22	4-20mA²(-1999-9999)
07	T(-200-400°C)	15	4-20mA(-1999-9999)	23	Multiple input

■ First-level parameters setting

Push down the SET key for 3 second, will enter the following menu: can select the next parameter by clicking the minus key, the parameters is changed cyclically. If you want set the current parameter, can click SET key to enter the detailed parameters, you can modify it by clicking shift key, add and minus key, when finished, can click the SET key to confirm. If you want return the measured interface, can push down SET for 3 second to quite.

Parameter	Function	Measured range	Default
AH	Upper alarm value	-1999-9999	300.0
dH	Upper alarm hysteresis	0-9999	1.0
AL	Lower alarm value	-1999-9999	200.0
dL	Lower alarm hysteresis	0-9999	1.0
AHH	Upper upper alarm value	-1999-9999	400.0
dhh	Upper upper alarm value hysteresis	0-9999	1.0
ALL	Lower lower alarm value	-1999-9999	100.0
dLL	Lower lower alarm hysteresis	0-9999	10
PASS	Second-level menu password	PASS	0 (When input 555, enter the second-level menu)

■ Second-level parameters setting

When appear PASS parameter in the first-level menu, can click SET key, input password 555 in the PV window, then click SET key to enter the second-level menu, the set parameter, save parameter and quite menu is same as the first-level parameters setting.

Parameter	Name	Set range	Default	Description
Sn	Input type	0-22	15	See input type table
dOt	Decimal point	0、1、2、3	1	0: Without decimal point 1: Ten decimals (show XXX.X) 2: Hundred decimals (show XX.XX) 3: Thousand decimals (show X.XXX)
PUL	Lower limit of measured range	-1999-9999	0.0	Set the input signal's lower limit measured value
PUH	Upper limit of measured range	-1999-9999	500.0	Set the input signal's upper limit measured value
PbIR	Zero shift	-100-100	0.0	Set zero point's shift value
FILT	Filter coefficient	0.100-9.999	0.100	As the filter coefficient increases, the displayed value becomes stable, but the lag increases.
K1/SUH	Input range's magnification	0.100-9.999 magnification	1.000	Set input range's magnification
OU-A	Transmission output	1、2	2	1: 0-10mA 2: 4-20mA
PH	Upper limit alarm type	1、2	1	1 upward alarm 2 downward alarm
PL	Lower limit alarm type	1、2	2	1 upward alarm 2 downward alarm
PHH	Upper upper limit alarm type	1、2	1	1 upward alarm 2 downward alarm
PLL	Lower lower limit alarm type	1、2	2	1 upward alarm 2 downward alarm
InPH	Non-standard signal input Maximum	0-400	100	Only used when sn = 16 or 17 (see Note 1)
InPL	Non-standard signal input minimum	0-400	0	Only used when sn = 16 or 17 (see Note 1)
bRUD	Communication baud rate		3	0=1200bps 1=2400bps 2=4800bps 3=9600bps
Id	Communication address	0-31	1	Cannot exceed 31

Note 1: Connect to the remote pressure gauge output, take the range of 0~1Mpa output 0~375Ω as an example, set Sn to 17, dot=2, PUL=0.00, and PUH=1.00, InPL=0, InPH=375, set it up, and the measured value can be displayed!

■ Application description

The range selection of instrument and sensor: All sensor's range must be same as instrument's range, otherwise, the display will display wrong value. For example: Liquid level transmitter range is 0-5m (According to the sensor label), output 4-20mA, can set the instrument as the following: 1). enter the second-level parameters menu. 2). Set the parameters as follow:

Parameter	Name	Set value	Description
Sn	Input type	15	Must be same as the output signal
Dot	Decimal point	2	According to the accuracy requirement
PuL	Lower limit of measured range	0.00	The lowest range of the sensor
PuH	Upper limit of measured range	5.00	The highest range of the sensor

Can see the following three examples, the transmitter is 0-5m

Example 1: Require instrument alarm when higher than 4m or lower than 1m. Push down the SET key for 3 second, enter the first-level parameters menu, the parameters are as follow:

Parameter	Name	Set value	Description
AH	Upper alarm value	4.00	The relay output is upper alarm
dH	Upper alarm hysteresis	0.05	Can be set freely
AL	Lower alarm value	1.00	The relay output is lower alarm
dL	Lower alarm hysteresis	0.05	Can be set freely

Example 2: Require start pump when lower than 1m, stop pump when higher than 4m. Push down the SET key for 3 second, enter the first-level parameters menu, the parameters are as follow:

Parameter	Name	Set value	Description
AL	Lower alarm value	1.00	The relay output is lower alarm
dL	Lower alarm hysteresis	3.00	

Example 3: Require start pump when higher than 4m, stop pump when lower than 1m. Push down the SET key for 3 second, enter the first-level parameters menu, the parameters are as follow:

Parameter	Name	Set value	Description
AH	Upper alarm value	4.00	The relay output is upper alarm
dH	Upper alarm hysteresis	3.00	

The upper upper limit and upper limit, lower lower limit and lower limit, their function are same in default. According the actual requirement Buyer can select It themselves (Can change it by the actual requirement)

Example 4: Adjustable the light beam, when buyer use the light beam instrument, if transformer range is 0-8m, the actual measured liquid level is 0-5m, need the light beam's percent display changed as 0-5m, display actual measured value. Can set the parameters as follow: set Sn=15, dot=2, PUL=0.00, PUH=8.00, SUH=8.00/5.00=1.600